




Water Sampling Sites

0 1,500 3,000 Feet

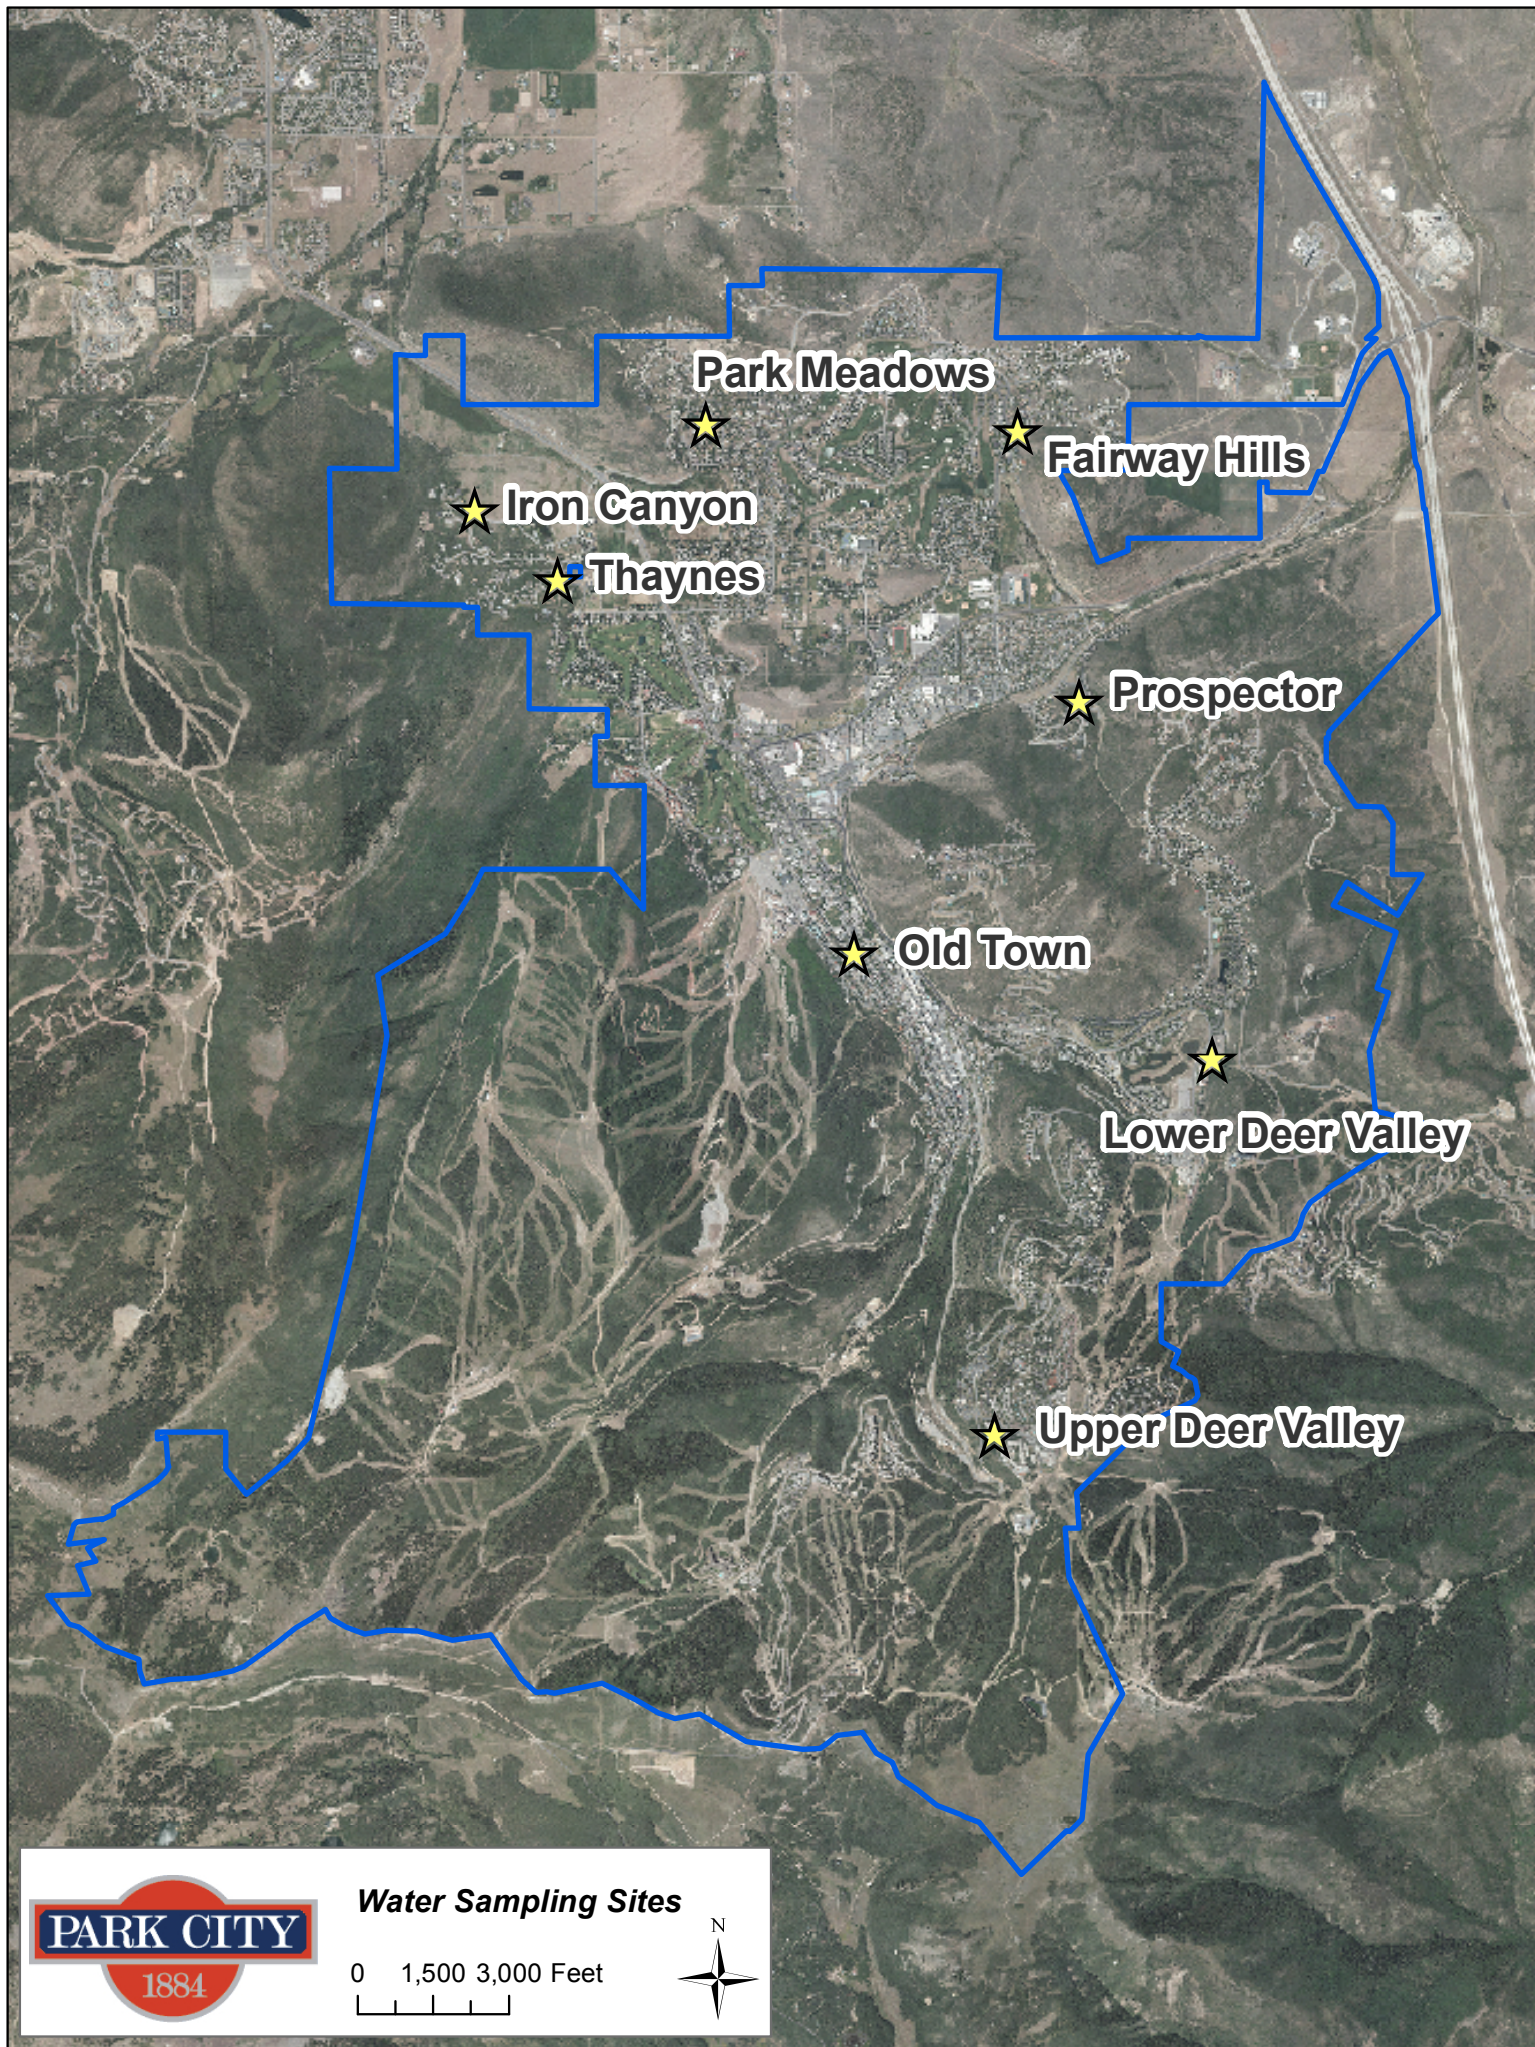

	Unit	MCL	Prospector				Upper Deer Valley				Lower Deer Valley				Old Town			
			3rd Qtr	4th Qtr	1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	1st Qtr	2nd Qtr
			2025	2025	2026	2026	2025	2025	2026	2026	2025	2025	2026	2026	2025	2025	2026	2026
Alkalinity	mg/l	N/A	134	157	199	147	14	34.0	18.7	15.5	138	121	127	16.0	134	121	125	18.6
Antimony	mg/l	0.006	0.0031	0.0017	< 0.0005	< 0.0005	0.0051	0.0047	0.005	0.0052	0.0034	0.0027	0.0042	0.0052	0.0032	0.0028	0.0051	0.0051
Arsenic	mg/l	0.01	0.0006	0.0007	0.0007	0.0006	0.0028	0.0027	0.003	0.0024	0.0005	0.0011	0.0005	0.0021	0.0005	0.001	0.0005	0.0021
Calcium	mg/l	N/A	105.0	105	65	46.2	83.3	91.1	81	84.6	115	97	87.1	83.5	107	94.4	87.4	85.7
Cadmium	mg/l	0.005	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002
Chloride (1)	mg/L	250	10.7	75	52.3	23.4	53.2	49.5	50.6	52	11.6	35.8	14.7	52.5	16.8	38.2	14.6	50.8
Copper (2)	mg/l	1.3	0.0014	< 0.0010	< 0.0010	0.001	< 0.0010	< 0.0010	0.0032	0.0078	0.0012	< 0.0010	0.001	< 0.0010	0.0026	0.0024	0.0018	< 0.0010
Fluoride	mg/l	4.0	0.1	< 0.100	< 0.100	< 0.100	0.148	0.170	0.179	0.160	< 0.100	0.1	< 0.100	0.2	< 0.100	0.1	< 0.100	0.162
Hardness	mg/l	N/A	361	369	230	161	315	335	308	321	392	345	312	315	372	336	314	324
Hardness	gpg	N/A	21	22	13	9	18	20	18	19	23	20	18	18	22	20	18	19
Iron (1)	mg/l	0.3	0.04	< 0.03	0.13	0.05	< 0.03	0.05	0.09	0.68	< 0.03	0.08	< 0.03	0.07	< 0.03	< 0.03	< 0.03	< 0.03
Lead (2)	mg/l	0.015	0.0013	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	0.0009	0.0013	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005
Magnesium	mg/l	N/A	24	26.2	16.4	11.1	26.1	26.2	25.6	26.6	25.4	25.1	22.9	25.8	25.2	24.4	23.3	26.8
Manganese (1)	mg/l	0.05	< 0.0007	< 0.0007	0.004	0.0025	< 0.0007	0.0008	< 0.0007	0.001	0.0008	0.0013	0.0007	0.0012	< 0.0007	< 0.0007	< 0.0007	< 0.0007
pH	SU	N/A	7.6	7.6	7.8	7.8	7.8	8.7	7.9	7.7	7.5	7.9	7.8	7.9	7.7	7.9	7.8	7.8
Sodium	mg/l	N/A	27.6	46.6	27.4	15	17.1	19.2	16.1	16.9	29	27.1	23.9	16.7	29.8	28.5	24	17.1
Sulfate (3)	mg/l	1000	258	169	24.3	11.6	239	241	246	247	273	193	211	246	265	195	214	246
Total Dissolved Solids (4)	mg/l	2000	556	520	348	224	540	476	448	452	624	464	492	468	588	476	472	456
Thallium	mg/l	0.002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	0.0004	0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002
Zinc (1)	mg/l	5.0	0.04	0.03	< 0.01	< 0.01	0.10	0.06	0.09	0.14	0.06	0.12	0.04	0.10	0.05	0.05	0.03	0.10

	Unit	MCL	Thaynes				Iron Canyon				Park Meadows				Fairway Hills			
			3rd Qtr	4th Qtr	1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	1st Qtr	2nd Qtr
			2025	2025	2026	2026	2025	2025	2026	2026	2025	2025	2026	2026	2025	2025	2026	2026
Alkalinity	mg/l	N/A	137	129	128	115	137	129	125	119	134	129	143	123	134	142	142	130
Antimony	mg/l	0.006	0.0035	0.0030	0.0048	0.0047	0.0035	0.003	0.0045	0.0047	0.0031	0.0033	0.0039	0.0040	0.0031	0.0023	0.0036	0.0027
Arsenic	mg/l	0.01	0.0005	0.0005	0.0006	0.0005	0.0005	0.0005	0.0006	0.0005	0.0005	0.0005	0.0006	0.0005	0.0006	0.0007	0.0005	0.0005
Calcium	mg/l	N/A	117.0	105	89	81.9	117.0	105	89	86.4	111	97.2	84.9	77.5	112.0	117	84	66.7
Cadmium	mg/l	0.005	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002
Chloride (1)	mg/L	250	10.4	11.2	14.4	14.7	10.4	11.2	13.7	16.3	10.7	15.3	22.4	16.7	11.1	89.4	22.7	18.7
Copper (2)	mg/l	1.3	0.0117	0.0121	0.0092	0.0133	0.0117	0.0121	0.0063	0.0035	0.0038	0.0015	0.0022	0.0029	0.0015	0.0013	0.001	0.0017
Fluoride	mg/l	4.0	< 0.100	< 0.100	< 0.100	< 0.100	< 0.100	< 0.100	< 0.100	< 0.100	< 0.100	< 0.100	< 0.100	< 0.100	< 0.100	< 0.100	< 0.100	< 0.100
Hardness	mg/l	N/A	397	369	320	300	397	369	319	315	381	345	303	283	384	415	301	241
Hardness	gpg	N/A	23	22	19	18	23	22	19	18	22	20	18	17	22	24	18	14
Iron (1)	mg/l	0.3	< 0.03	< 0.03	< 0.03	< 0.03	< 0.03	< 0.03	0.03	< 0.03	< 0.03	< 0.03	< 0.03	< 0.03	< 0.03	0.04	< 0.03	< 0.03
Lead (2)	mg/l	0.015	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005
Magnesium	mg/l	N/A	25.6	25.9	23.8	23.3	25.6	25.9	23.4	24.2	25.1	24.7	22.2	21.7	25.3	29.9	22.1	18.1
Manganese (1)	mg/l	0.05	< 0.0007	< 0.0007	< 0.0007	< 0.0007	< 0.0007	< 0.0007	< 0.0007	< 0.0007	< 0.0007	< 0.0007	< 0.0007	< 0.0007	0.0012	< 0.0007	< 0.0007	< 0.0007
pH	SU	N/A	7.5	7.6	7.7	7.5	7.5	7.6	7.8	7.6	7.5	8.0	7.7	7.6	7.5	7.5	7.7	7.6
Sodium	mg/l	N/A	28.8	27.3	25.7	20.7	28.8	27.3	24.4	22.9	28.7	28.5	26	20.5	28.9	56.1	25.7	18.4
Sulfate (3)	mg/l	1000	276	239	225	200	276	239	218	203	269	213	185	165	270	223	186	119
Total Dissolved Solids (4)	mg/l	2000	664	520	416	456	664	520	464	424	564	468	448	396	584	652	480	332
Thallium	mg/l	0.002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002
Zinc (1)	mg/l	5.0	0.06	0.06	0.04	0.06	0.06	0.06	0.03	0.05	0.04	0.03	0.02	0.04	0.04	0.04	0.02	0.03

Key

mg/l - This unit describes the level of the detected substance. One mg/l is approximately equal to one drop of food coloring in 13 gallons of water.

gpg - Grain per gallon is a unit of water hardness defined as 1 grain (64.8 milligrams) of calcium carbonate dissolved in 1 gallon of water

MCL - Maximum Contaminant Level set by the Environmental Protection Agency; See definition in Annual Water Quality Consumer Confidence Report

N/A - Not applicable

NS - Not sampled (heavy snow and ice accumulation prevented vault entry)

(1) Secondary MCLs have been established by EPA for iron, manganese, chloride and zinc. EPA does not enforce SMCLs. They are established only as guidelines to assist public water

systems in managing their drinking water for aesthetic considerations such as color, taste and odor. These substances are not considered to present a risk to human health at the SMCL.

(2) Action levels have been established, rather than MCLs. If an action level is exceeded in over 10% of samples collected within homes, steps must be taken to reduce the concentrations to below the action level.

(3) Utah MCL for sulfate is 1000 mg/L. UDEQ DDW requires that if the sulfate level is greater than 500 mg/L, the water system shall satisfactorily demonstrate that: (a) No better quality water is available, and (b) The water shall not be available for human consumption from commercial establishments. In no case shall DDW allow the use of water having a sulfate level greater than 1000 mg/L. (The federal government has a secondary, or aesthetic, standard for sulfate of 250 mg/L). Park City is taking active measures to minimize TDS concentrations through source blending.

(4) Utah MCL for TDS is 2000 mg/L. UDEQ DDW requires that if the TDS is greater than 1000 mg/L, the water system shall satisfactorily demonstrate to DDW that no better water is available. DDW shall not allow the use of an inferior source of water if a better source of water (i.e. lower in TDS) is available. (The federal government has a secondary, or aesthetic, standard for TDS of 500 mg/L).