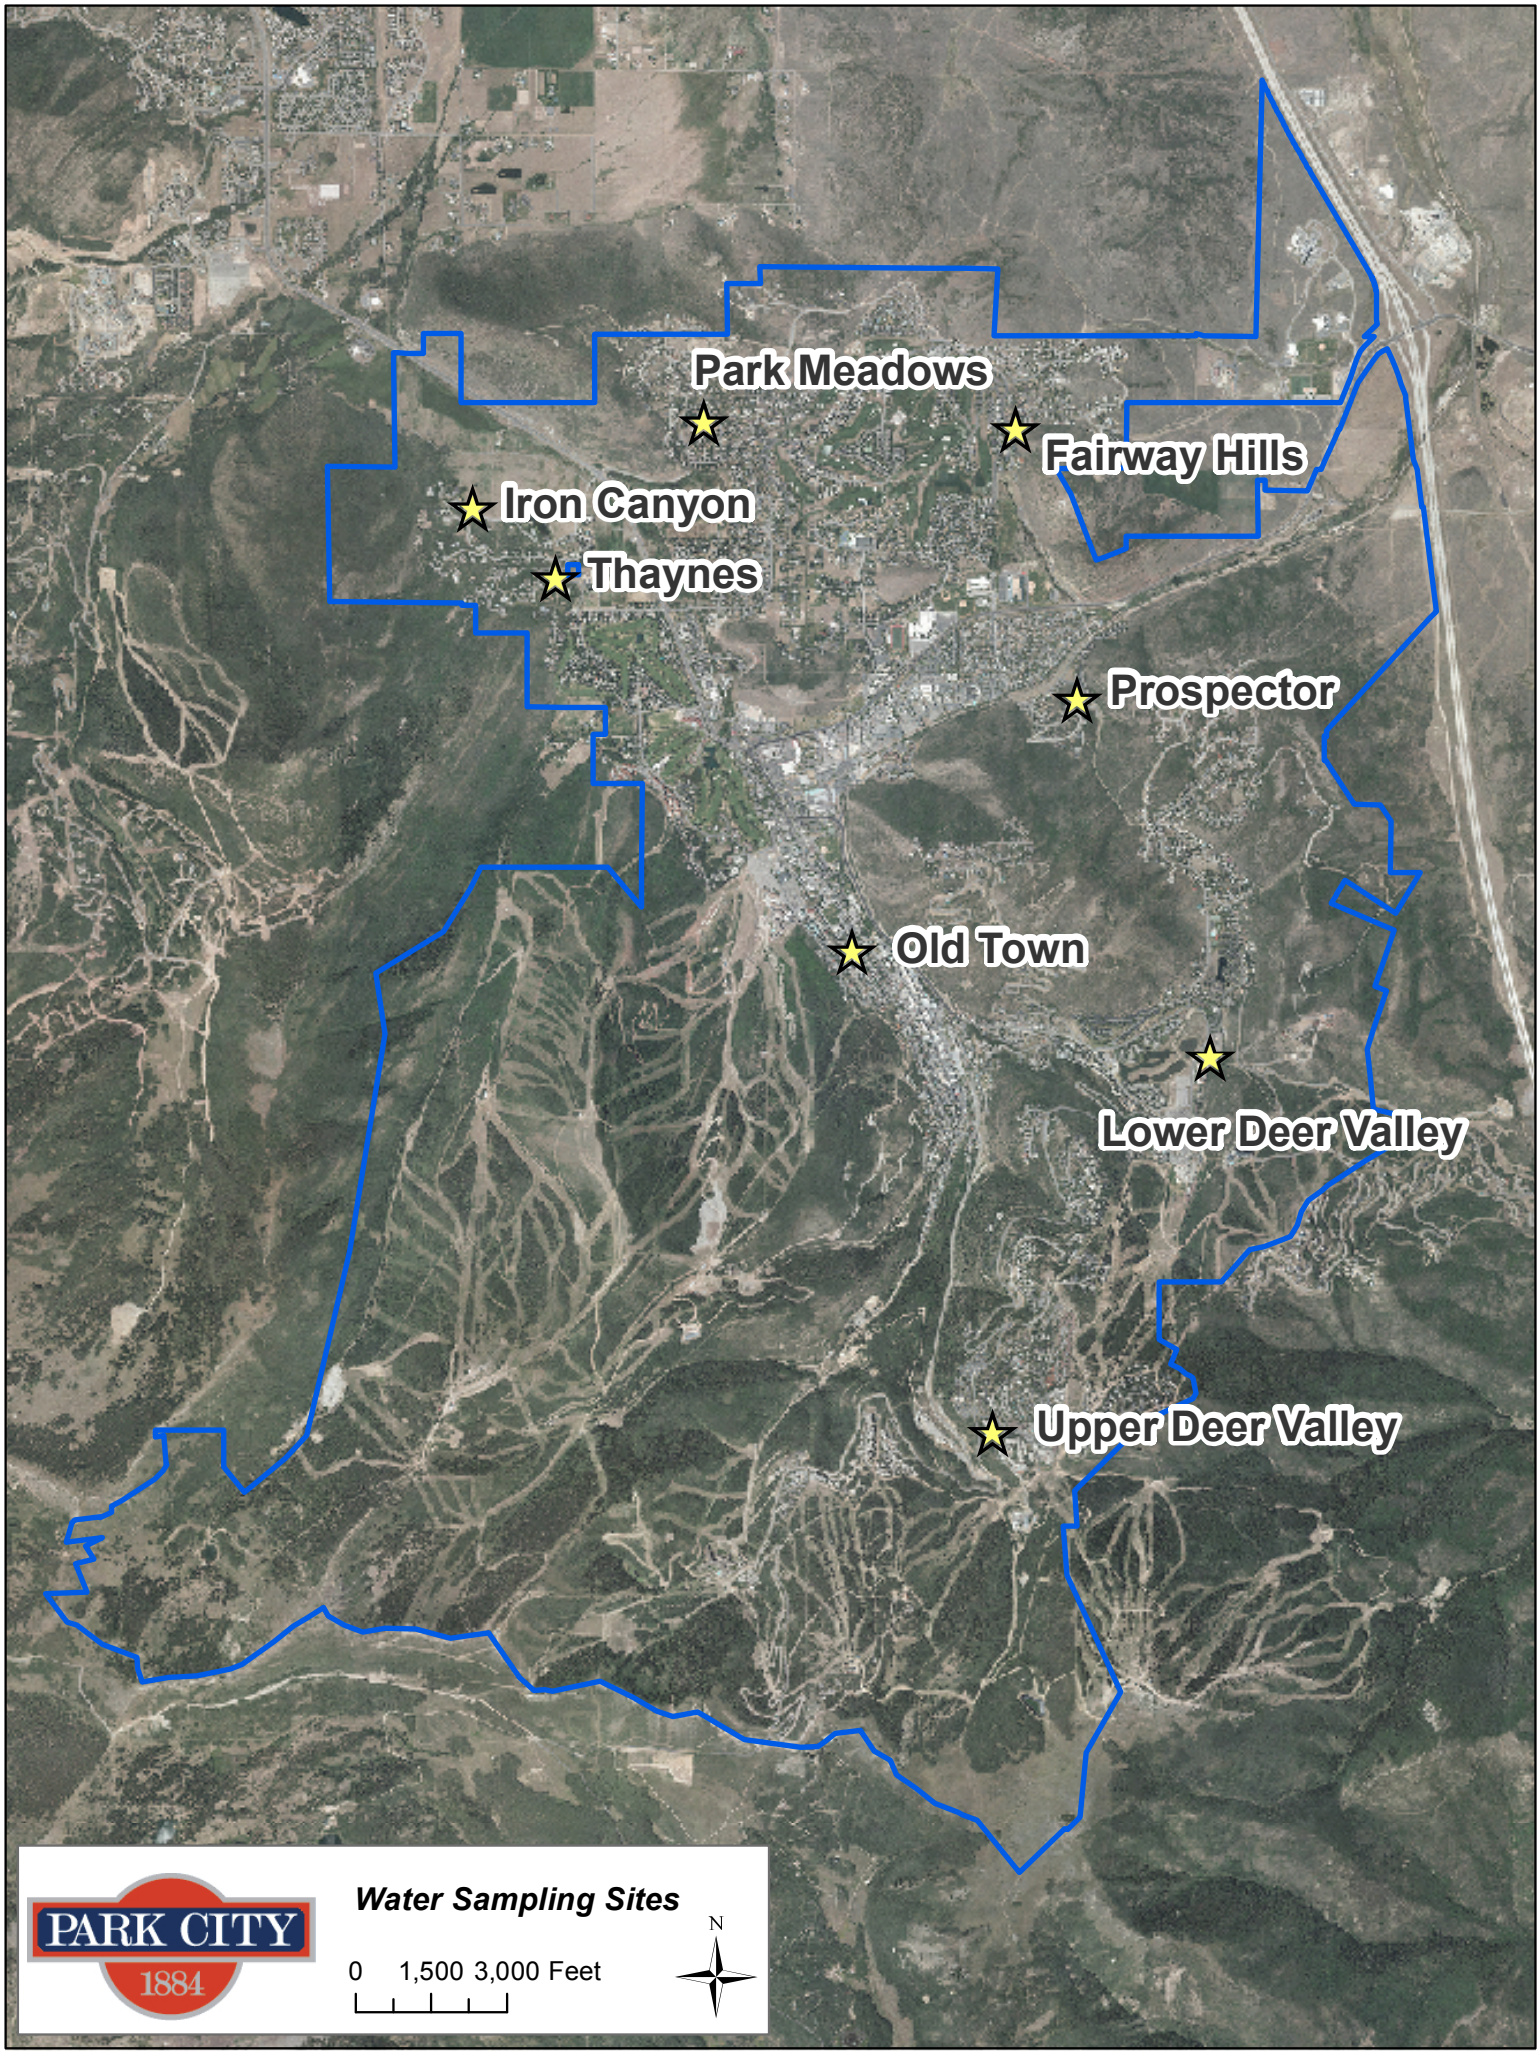

Park Meadows
Fairway Hills
Iron Canyon
Thaynes
Prospector
Old Town
Lower Deer Valley
Upper Deer Valley
PARK CITY
1884
Water Sampling Sites
0 1,500 3,000 Feet
N

	Unit	MCL	Prospector				Upper Deer Valley				Lower Deer Valley				Old Town			
			4th Qtr	1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	1st Qtr	2nd Qtr	3rd Qtr
			2025	2026	2026	2026	2025	2026	2026	2026	2025	2026	2026	2026	2025	2026	2026	2026
Alkalinity	mg/l	N/A	157	199	147	164	34.0	18.7	15.5	13.8	121	127	16.0	55.4	121	125	18.6	58.1
Antimony	mg/l	0.006	0.0017	< 0.0005	< 0.0005	0.0008	0.0047	0.005	0.0052	0.0048	0.0027	0.0042	0.0052	0.0041	0.0028	0.0051	0.0051	0.0043
Arsenic	mg/l	0.01	0.0007	0.0007	0.0006	0.0007	0.0027	0.003	0.0024	0.0021	0.0011	0.0005	0.0021	0.0018	0.001	0.0005	0.0021	0.002
Calcium	mg/l	N/A	105	65	46.2	63.7	91.1	81	84.6	84.5	97	87.1	83.5	88.6	94.4	87.4	85.7	92.6
Cadmium	mg/l	0.005	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002
Copper (2)	mg/l	1.3	< 0.0010	< 0.0010	0.001	0.0012	< 0.0010	0.0032	0.0078	< 0.0010	< 0.0010	0.001	< 0.0010	< 0.0010	0.0024	0.0018	< 0.0010	0.0013
Hardness	mg/l	N/A	369	230	161	222	335	308	321	322	345	312	315	327	336	314	324	340
Hardness	gpg	N/A	22	13	9	13	20	18	19	19	20	18	18	19	20	18	19	20
Iron (1)	mg/l	0.3	< 0.03	0.13	0.05	< 0.03	0.05	0.09	0.68	< 0.03	0.08	< 0.03	0.07	0.03	< 0.03	< 0.03	< 0.03	< 0.03
Lead (2)	mg/l	0.015	< 0.0005	< 0.0005	< 0.0005	0.0008	< 0.0005	0.0009	0.0013	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005
Magnesium	mg/l	N/A	26.2	16.4	11.1	15.3	26.2	25.6	26.6	26.9	25.1	22.9	25.8	25.8	24.4	23.3	26.8	26.4
Manganese (1)	mg/l	0.05	< 0.0007	0.004	0.0025	< 0.0007	0.0008	< 0.0007	0.001	< 0.0007	0.0013	0.0007	0.0012	0.0008	< 0.0007	< 0.0007	< 0.0007	< 0.0007
pH	SU	N/A	7.6	7.8	7.8	7.8	8.7	7.9	7.7	8.1	7.9	7.8	7.9	7.8	7.9	7.8	7.8	7.8
Sodium	mg/l	N/A	46.6	27.4	15	20.9	19.2	16.1	16.9	16.5	27.1	23.9	16.7	20.8	28.5	24	17.1	22.3
Total Dissolved Solids (3)	mg/l	2000	520	348	224	296	476	448	452	328	464	492	468	500	476	472	456	520
Thallium	mg/l	0.002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002
Zinc (1)	mg/l	5.0	0.03	< 0.01	< 0.01	0.01	0.06	0.09	0.14	0.11	0.12	0.04	0.10	0.08	0.05	0.03	0.10	0.07

	Unit	MCL	Thaynes				Iron Canyon				Park Meadows				Fairway Hills			
			4th Qtr	1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	1st Qtr	2nd Qtr	3rd Qtr
			2025	2026	2026	2026	2025	2026	2026	2026	2025	2026	2026	2026	2025	2026	2026	2026
Alkalinity	mg/l	N/A	129	128	115	122	129	125	119	128	129	143	123	134	142	142	130	158
Antimony	mg/l	0.006	0.0030	0.0048	0.0047	0.0037	0.003	0.0045	0.0047	0.0038	0.0033	0.0039	0.0040	0.0041	0.0023	0.0036	0.0027	0.0015
Arsenic	mg/l	0.01	0.0005	0.0006	0.0005	0.0007	0.0005	0.0006	0.0005	0.0007	0.0005	0.0006	0.0005	0.0007	0.0007	0.0005	0.0005	0.0007
Calcium	mg/l	N/A	105	89	81.9	86.6	105	89	86.4	86.9	97.2	84.9	77.5	112	117	84	66.7	80.2
Cadmium	mg/l	0.005	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002
Copper (2)	mg/l	1.3	0.0121	0.0092	0.0133	0.0137	0.0121	0.0063	0.0035	0.0037	0.0015	0.0022	0.0029	0.0028	0.0013	0.001	0.0017	0.0013
Hardness	mg/l	N/A	369	320	300	307	369	319	315	308	345	303	283	394	415	301	241	281
Hardness	gpg	N/A	22	19	18	18	22	19	18	18	20	18	17	23	24	18	14	16
Iron (1)	mg/l	0.3	< 0.03	< 0.03	< 0.03	< 0.03	< 0.03	0.03	< 0.03	< 0.03	< 0.03	< 0.03	< 0.03	< 0.03	0.04	< 0.03	< 0.03	< 0.03
Lead (2)	mg/l	0.015	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005	< 0.0005
Magnesium	mg/l	N/A	25.9	23.8	23.3	22.1	25.9	23.4	24.2	22.1	24.7	22.2	21.7	27.6	29.9	22.1	18.1	19.7
Manganese (1)	mg/l	0.05	< 0.0007	< 0.0007	< 0.0007	< 0.0007	< 0.0007	< 0.0007	< 0.0007	< 0.0007	< 0.0007	< 0.0007	< 0.0007	< 0.0007	< 0.0007	< 0.0007	< 0.0007	< 0.0007
pH	SU	N/A	7.6	7.7	7.5	7.7	7.6	7.8	7.6	7.7	8.0	7.7	7.6	7.5	7.5	7.7	7.6	7.7
Sodium	mg/l	N/A	27.3	25.7	20.7	23.8	27.3	24.4	22.9	23.8	28.5	26	20.5	37.0	56.1	25.7	18.4	34.1
Total Dissolved Solids (3)	mg/l	2000	520	416	456	460	520	464	424	456	468	448	396	644	652	480	332	428
Thallium	mg/l	0.002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002	< 0.0002
Zinc (1)	mg/l	5.0	0.06	0.04	0.06	0.03	0.06	0.03	0.05	0.02	0.03	0.02	0.04	0.02	0.04	0.02	0.03	0.01

Key

mg/l - This unit describes the level of the detected substance. One mg/l is approximately equal to one drop of food coloring in 13 gallons of water.

gpg - Grain per gallon is a unit of water hardness defined as 1 grain (64.8 miligrams) of calcium carbonate dissolved in 1 gallon of water

MCL - Maximum Contaminant Level set by the Environmental Protection Agency; See definition in Annual Water Quality Consumer Confidence Report

N/A - Not applicable

NS - Not sampled (heavy snow and ice accumulation prevented vault entry)

(1) Secondary MCLs have been established by EPA for iron, manganese and zinc. EPA does not enforce SMCLs. They are established only as guidelines to assist public water systems in managing their drinking water for aesthetic considerations such as color, taste and odor. These substances are not considered to present a risk to human health at the SMCL.

(2) Action levels have been established, rather than MCLs. If an action level is exceeded in over 10% of samples collected within homes, steps must be taken to reduce the concentrations to below the action level.

(3) Utah MCL for TDS is 2000 mg/L. UDEQ DDW requires that if the TDS is greater than 1000 mg/L, the water system shall satisfactorily demonstrate to DDW that no better water is available. DDW shall not allow the use of an inferior source of water if a better source of water (i.e. lower in TDS) is available. (The federal government has a secondary, or aesthetic, standard for TDS of 500 mg/L).